


Ground Loop Isolator For 4-20 mA Analog Devices

Set the DIP Switches (S1) on the isolator module to the following positions

1 OFF Field/Factory
2 OFF

3 OFF
4 ON Output Range
5 ON

6 ON
7 OFF
8 OFF Input Range
9 OFF
10 ON

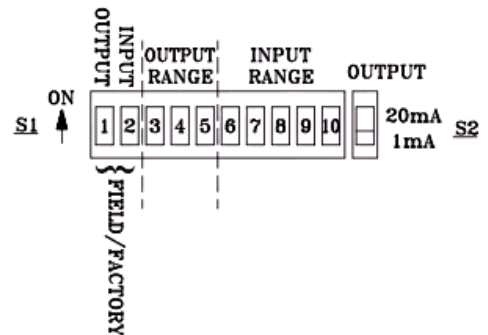

Set DIP Switch (S2) (the 20 mA/1 mA output) to ON for 20 mA Maximum output

